




NONDESTRUCTIVE TEST

PART 2 - X-RAY

ELEVATOR

Purpose

To detect moisture in honeycomb elevator tab structure.

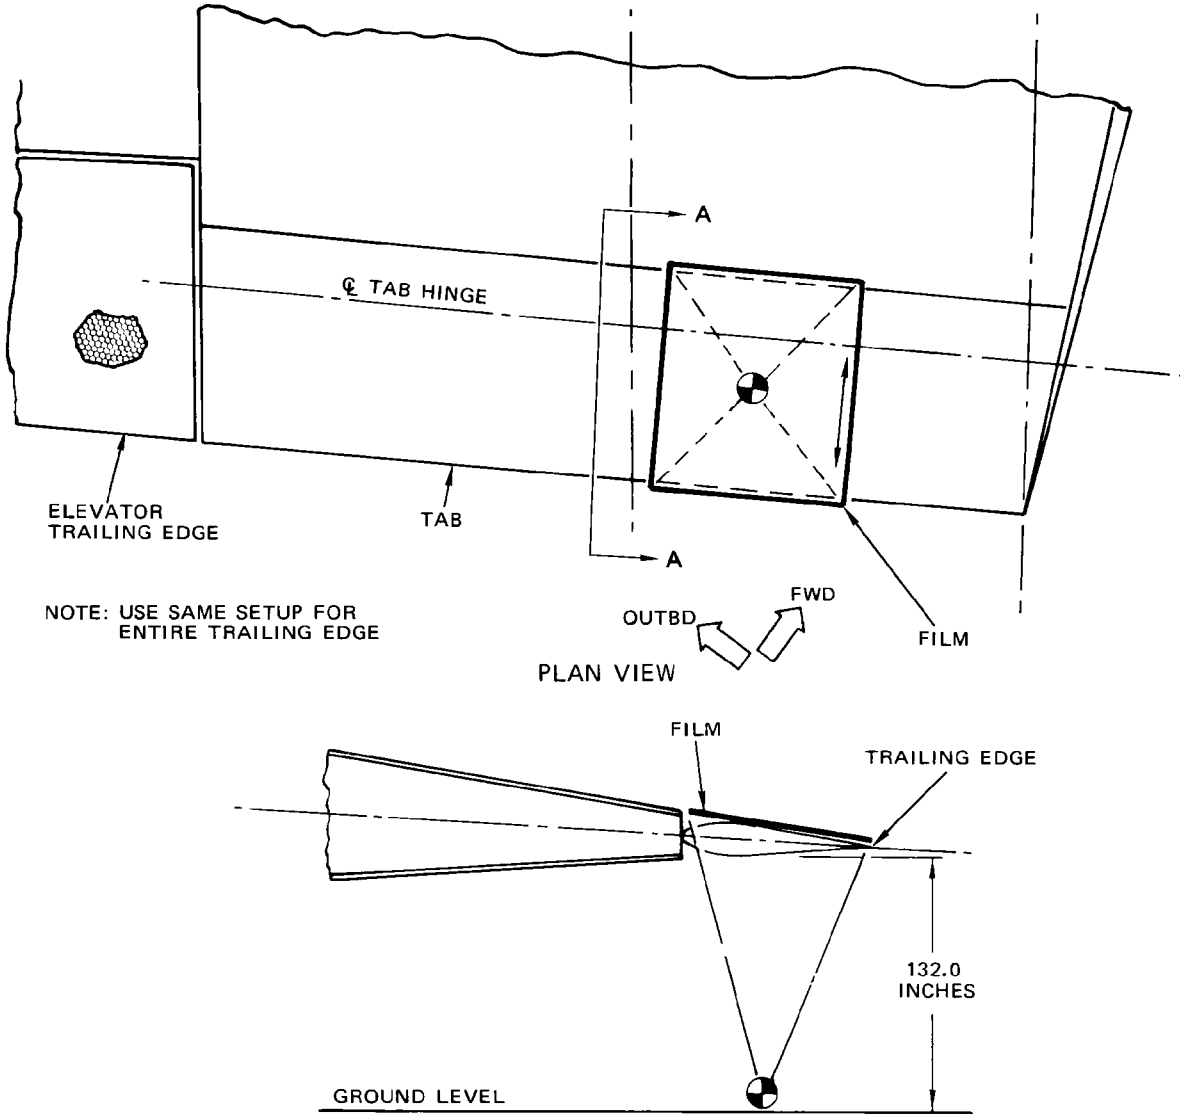

* [1] AS MANY EXPOSURES AND POSITIONS AS REQUIRED

CENTER X-RAY SOURCE ON FILM

EXPOSURE NUMBER	FILM			SFD	GENERATOR SETTINGS	
	POSITION	ASTM CLASS	SIZE		KV	MAS
*[1]	*[1]	I	10 x 12	132	90	210

Elevator Tabs
Figure 1